




Syncro

BMS GRAPHICS


cold	< 21°C
comfort	21°C -24°C
Hot	> 24°C

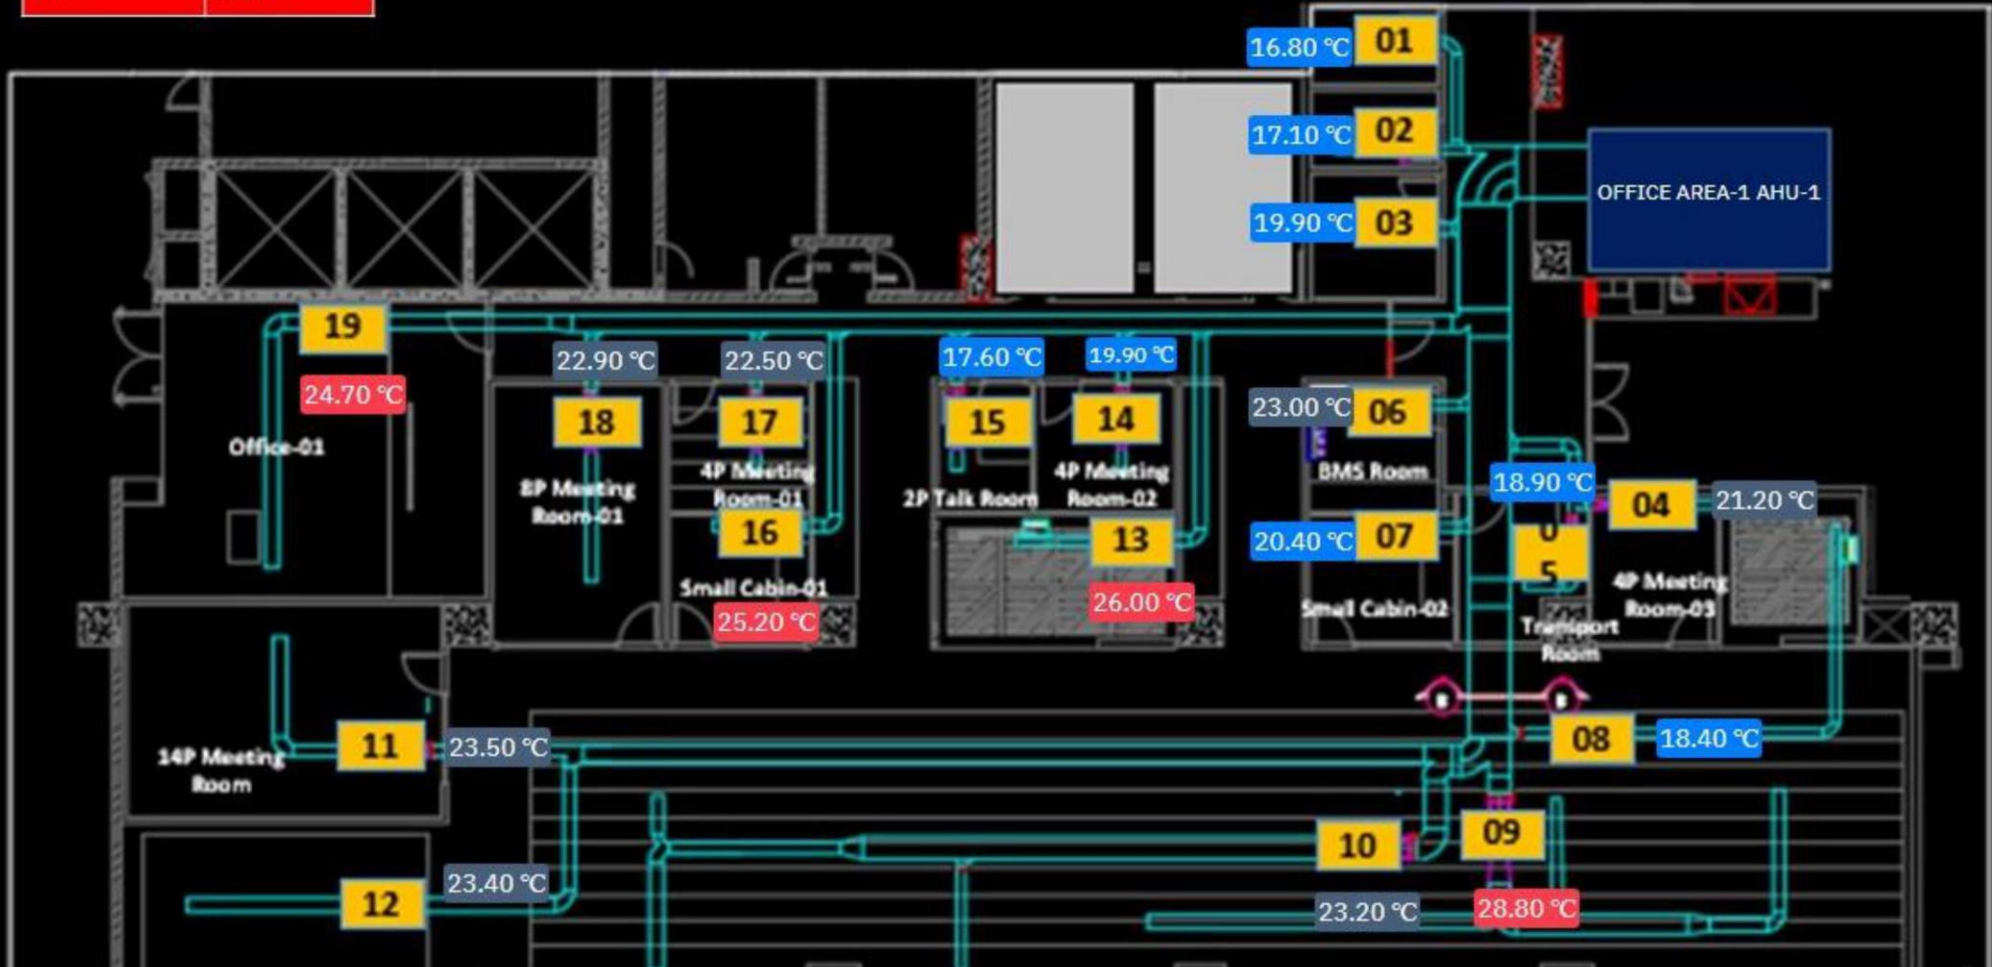

CO₂ 472.40

DUCT STATIC PRESSURE
78.70 Pa

NORMAL

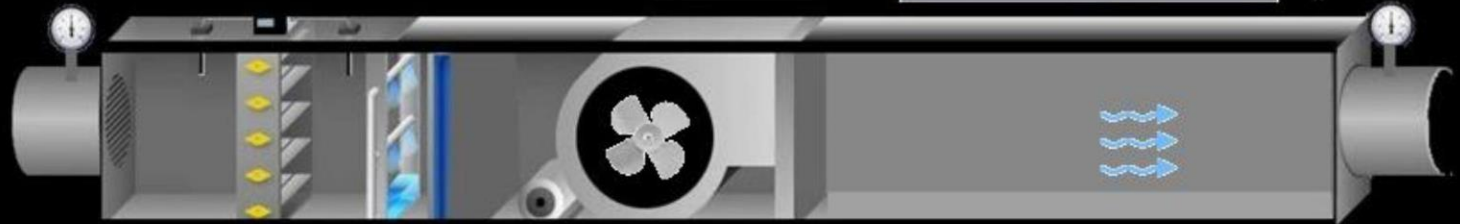

FILTER STATUS
CLEAN

FAN STATUS
ON

SUPPLY AIR STATUS
12.80 °C

CHW-ACT-FEEDBACK
0.30

AHU OPERATION STATUS	
AHU ON/OFF STS	ON
AHU A/M STS	AUTO
VFD/BYPASS STS	ON
TRIP STS	NORMAL

AHU PARAMETERS	
SA-TEMPRATURE	12.80
CHW - ACT - CMD	100.00
CHW-ACT-FEEDBACK	0.30
SAT - SETPOINT	0.00

AHU PARAMETERS	
DUCT STATIC PRESSURE	78.70
VFD - CMD	0.00
VFD - FEEDBACK	100.00
DSP - SETPOINT	0.00

FIRE DAMPER STATUS	
FIRE -DAMPER -1	OPEN
FIRE -DAMPER -2	OPEN
FIRE -DAMPER -3	OPEN
FIRE -DAMPER -4	OPEN



Home

Trend Logs

LOGO

Trend Logs

Alert Logs

Download

First << >> Last 0 - 92 of 92

04/23/2021



04/23/2021



ALL Device



ALL Properties



Search

S No	DateTime	Device Name	Properties	Location	Message
1	2021-04-23 18:21:00	2F-A01-VAV01	Zone Temp	WELLNESS ROOM - M	16.9
2	2021-04-23 18:21:00	2F-A01-VAV02	Zone Temp	WELLNESS ROOM - FM	17.2
3	2021-04-23 18:21:00	2F-A01-VAV03	Zone Temp	MOTHERS ROOM	19.9
4	2021-04-23 18:21:00	2F-A01-VAV04	Zone Temp	4P MEETING ROOM-03	21.2
5	2021-04-23 18:21:00	2F-A01-VAV05	Zone Temp	TRANSPORT ROOM	19.1
6	2021-04-23 18:21:00	2F-A01-VAV06	Zone Temp	BMS ROOM	23.1
7	2021-04-23 18:21:00	2F-A01-VAV07	Zone Temp	SMALL CABIN-02	20.5
8	2021-04-23 18:21:00	2F-A01-VAV08	Zone Temp	WORKSTATION-01	18.6
9	2021-04-23 18:21:00	2F-A01-VAV09	Zone Temp	WORKSTATION-01	28.8




Home

Analysis Reports

LOGO

04/23/2021 2F-A01-VAV08

Analysis Reports

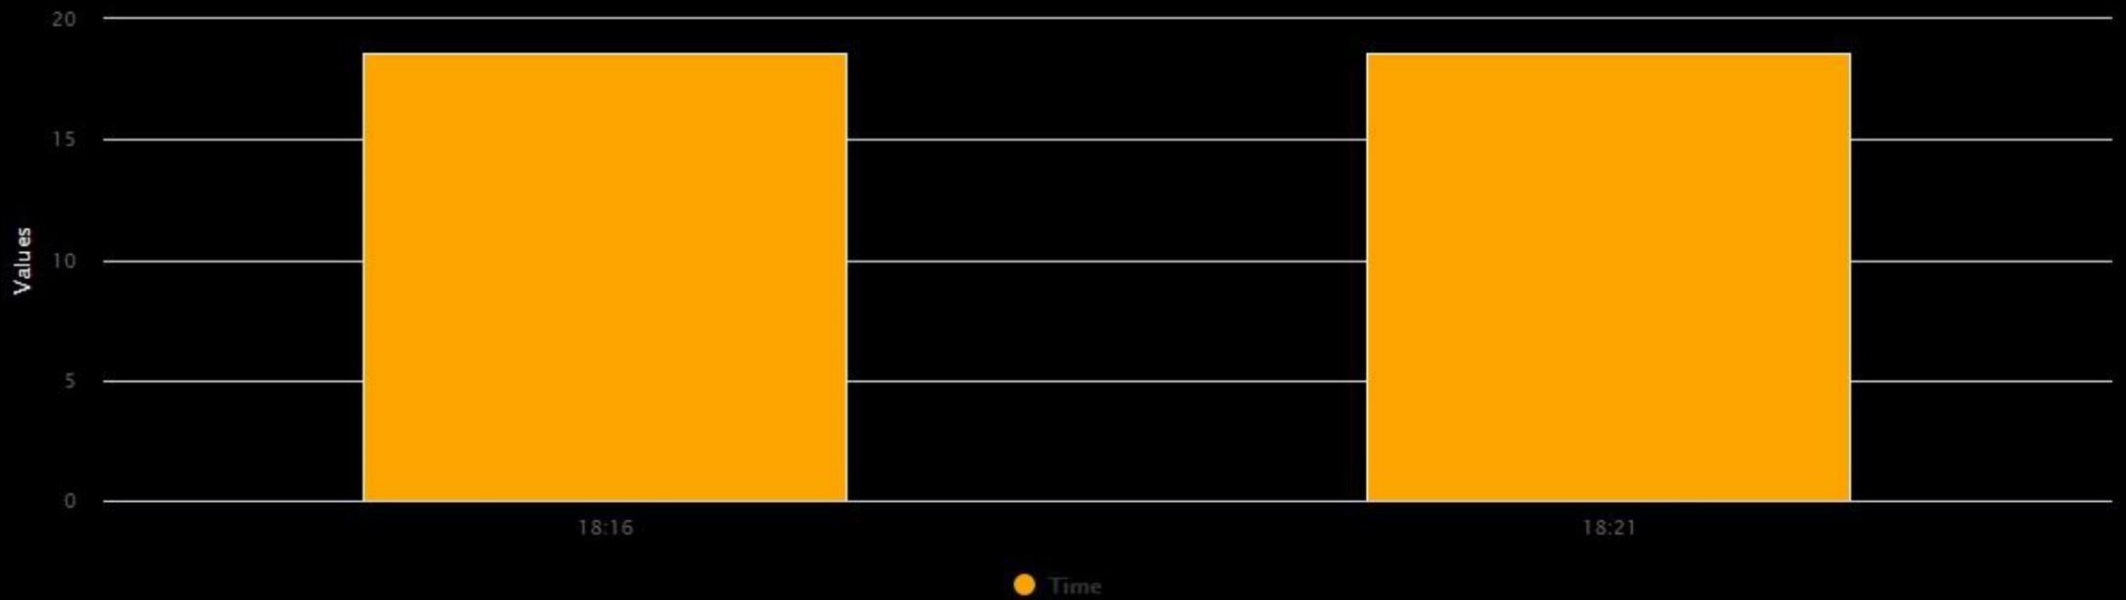

Home

13F-LAYOUT

LOGO

12F-LAYOUT

13F-LAYOUT

18F-LAYOUT

19F-LAYOUT

VAV ANALYSIS REPORT

13F-AHU



12F-LAYOUT


13F-LAYOUT

18F-LAYOUT

19F-LAYOUT

VAV ANALYSIS REPORT

12F-AHU

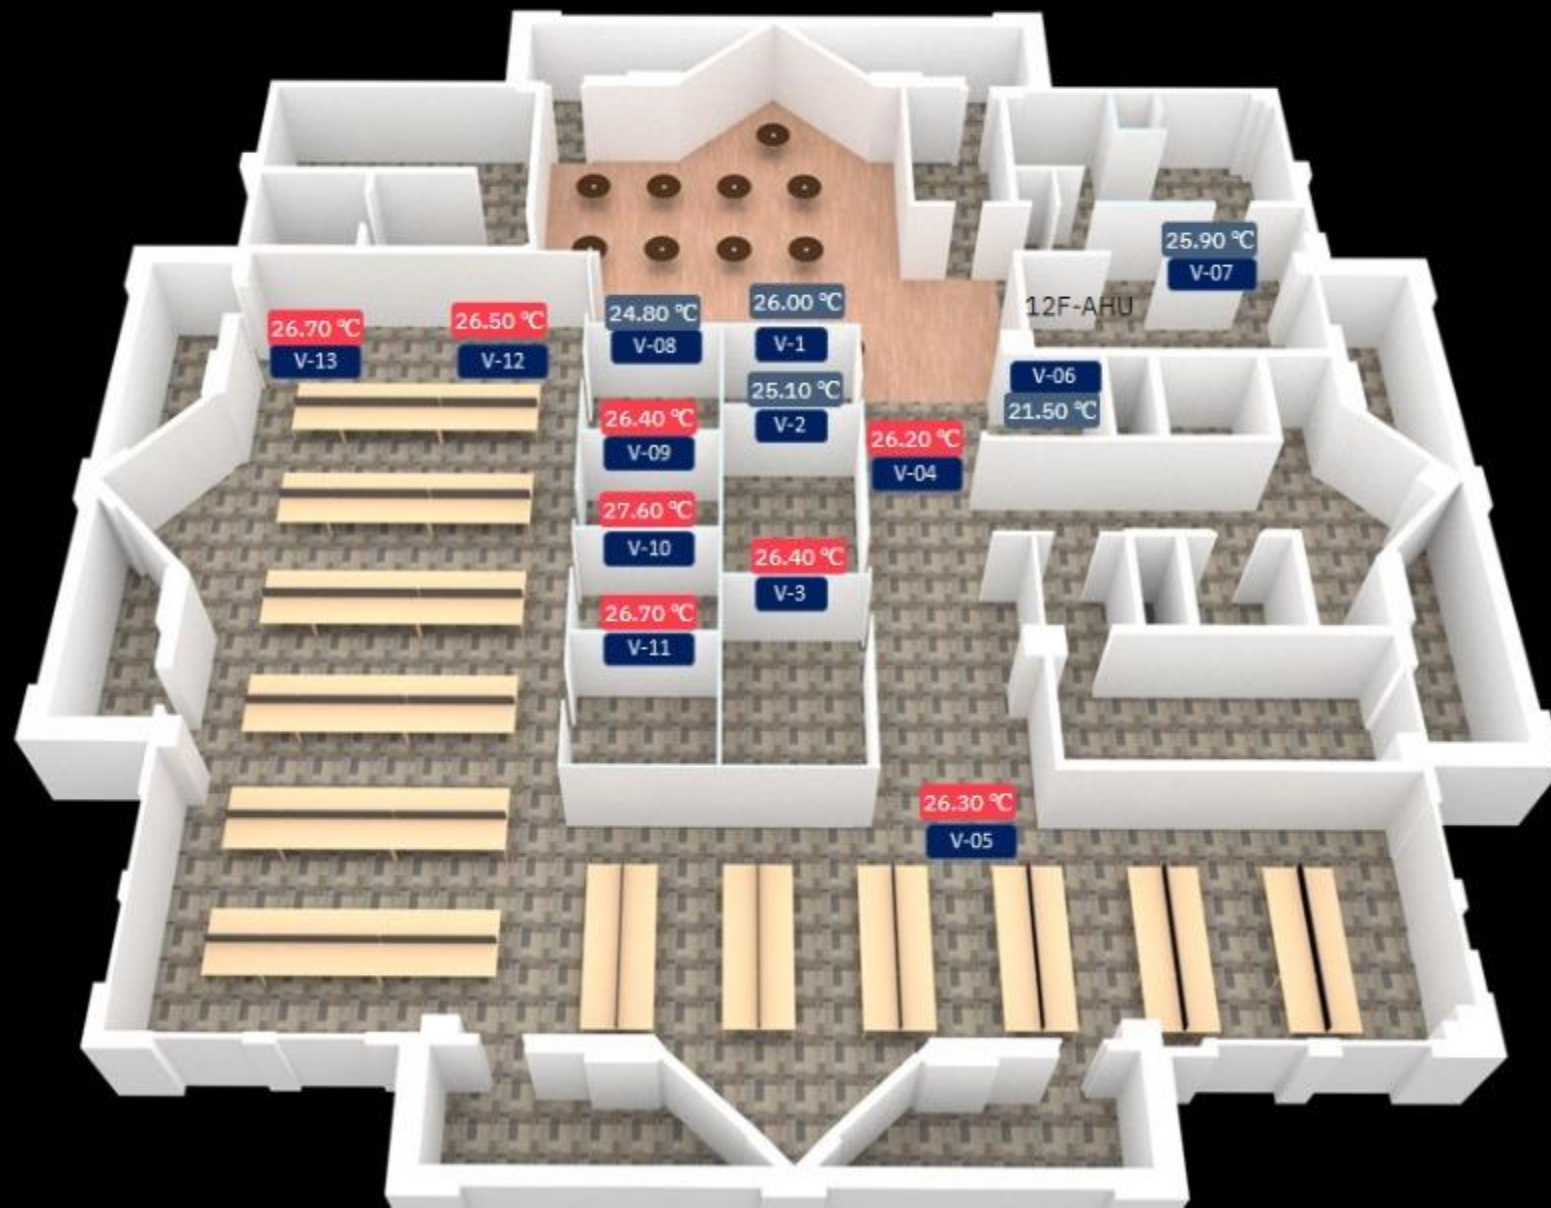


Cold	<20
Normal	20-24
Hot	>24

EM-38 L-N VOLT AVG



EM-33 L-N VOLT AVG



Parameters	EM-38 INCOMER-1 200A	EM-33 INCOMER-2 200A
L-N Volt Average	246.70 volts	247.10 volts
L-L Volt Average	426.70 volts	426.80 volts
R-Phase Current	3.50 amps	12.70 amps
Y-Phase Current	3.80 amps	7.70 amps
B-Phase Current	3.00 amps	8.20 amps
Current Average	3.50 amps	9.50 amps
VA Total	2356.90 VA	5787.10 VA
Watts Total	2191.70 watts	5779.80 watts
Wh Received	5147862.00 watts	387551.50 watts
VAh Received	0.00 VA	0.00 VA
PF Average	0.90 pf	-1.00 pf
Frequency	50.00 Hz	50.10 Hz

Press **Esc** to exit full screen

- 12F-AHU
- 13F-AHU
- 18F-AHU
- 19F-AHU

- HOURLY REPORTS
- TREND LOGS


CO₂
219.50 PPM

DUCT STATIC PRESSURE
0.20 Pa

SA-TEMP
25.70 °C

TOTAL CFM
93.50 CFM

RETURN CFM
0.00 CFM

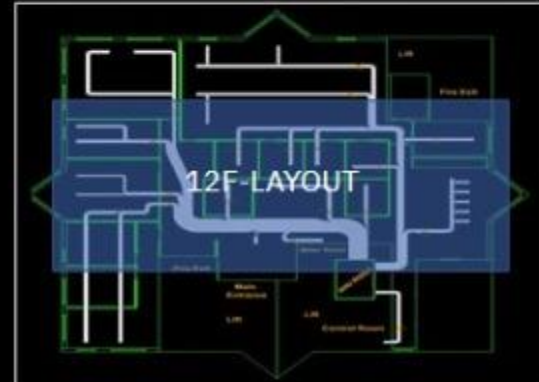

FILTER STATUS
CLEAN

AHU ON/OFF CMD

CHW-FEEDBACK
0.00 %

AHU PARAMETERS	
AUTO/MANUAL STS	AUTO
CHW-INLET TEMP	24.80 °C
CHW-OUTLET TEMP	26.20 °C
DSP - SETPOINT	80.00 Pa
SAT - SETPOINT	20.00 °C

PARAMETERS	
VFD - TRIP STATUS	NORMAL
SA-FIRE DAMPER STS	OPEN
RA-FIRE DAMPER STS	CLOSE
VFD RUN TIME	1437 HRS
VFD KWH	12212



VFD-SPEED



VFD-MOTOR SPEED



Home

AHU SUMMARY

LOGO

12F-AHU

13F-AHU


18F-AHU

19F-AHU

Parameters	12F 	13F 	18F 	19F 
On/Off Command	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
On/Off Status	OFF	OFF	OFF	OFF
Auto/Manual Status	AUTO	AUTO	AUTO	AUTO
VFD Speed	35.7 HZ	33 HZ	38 HZ	38 HZ
CO2 Level	221.10 PPM	244.60 PPM	248.30 PPM	231.70 PPM
Total CFM	84.60 CFM	7.30 CFM	74.10 CFM	206.60 CFM
Return Air CFM	0.00 CFM	1522.90 CFM	3598.60 CFM	2631.70 CFM
Supply Air Temp	25.70 °C	22.20 °C	25.90 °C	25.90 °C
Supply Air Temp-SP	22.00 °C	0.00 °C	22.00 °C	20.00 °C
Duct Static Pressure	0.20 Pa	55.90 Pa	2.40 Pa	0.00 Pa
Duct Static Pressure-SP	80.00 Pa	100.00 Pa	100.00 Pa	100.00 Pa
CHW Inlet Temp	24.80 °C	58.10 °C	26.40 °C	25.60 °C


Press Esc to exit full screen

Parameters	12F	18F	19F
On/Off Command	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
On/Off Status	ON	OFF	OFF
Auto/Manual Status	AUTO	AUTO	AUTO
Pantry Temp	-8.70 °C	-8.70 °C	30.30 °C
Pantry Temp Setpoint	22.00 °C	22.00 °C	22.00 °C
Actuator Control	0.00	0.00	0.00
Actuator Feedback	0.00 %	0.00 %	0.00 %

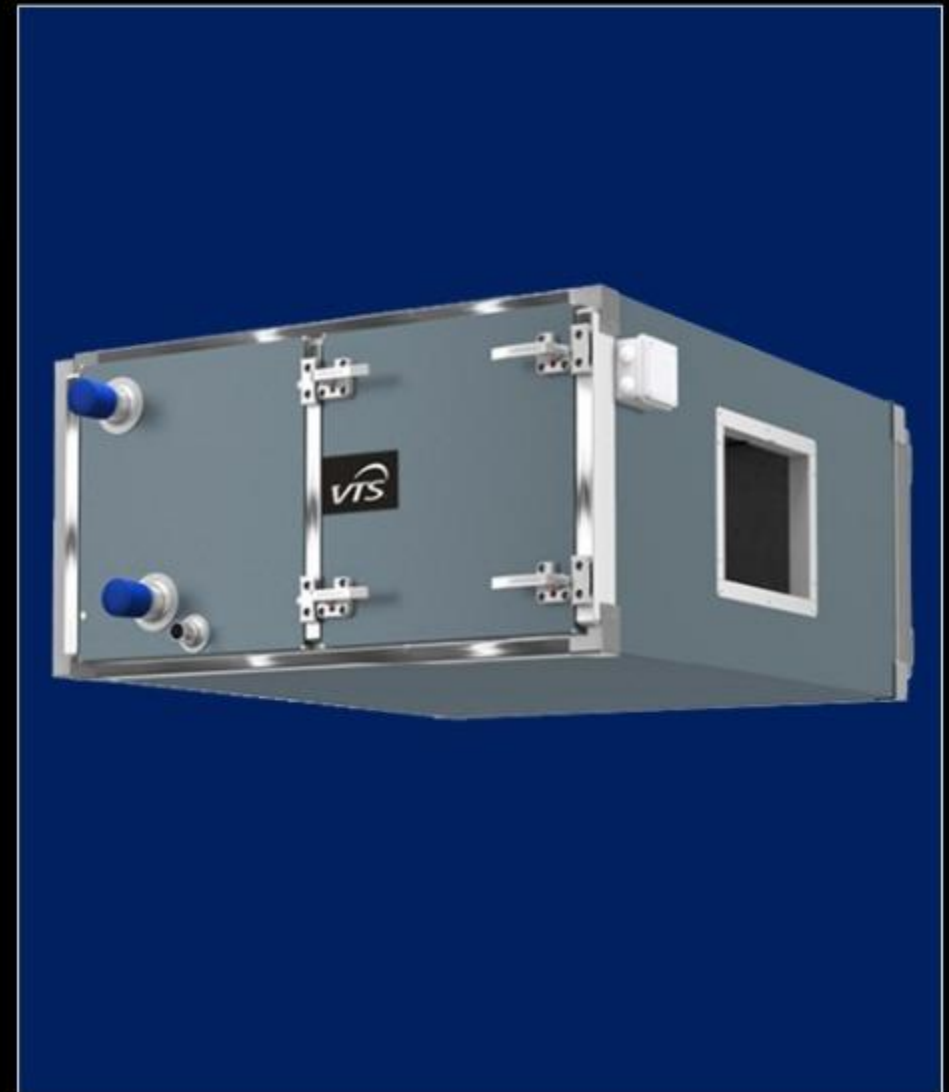



Damper Position	42.90 %
Air Flow	71.00 CFM
Temp SetPoint	17.00 °C
TH-SetPoint	17.00 °C

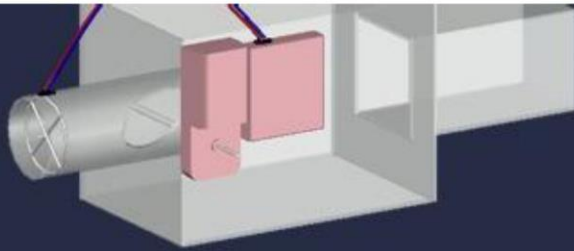

04/23/2021



Submit


Temperature Analysis of 2021-04-23



Activate Windows
Go to Settings to activate Windows.


Home

TOP-AHU01-LAYOUT



Cold	<20
Normal	20-24
Hot	>24

TREND LOGS

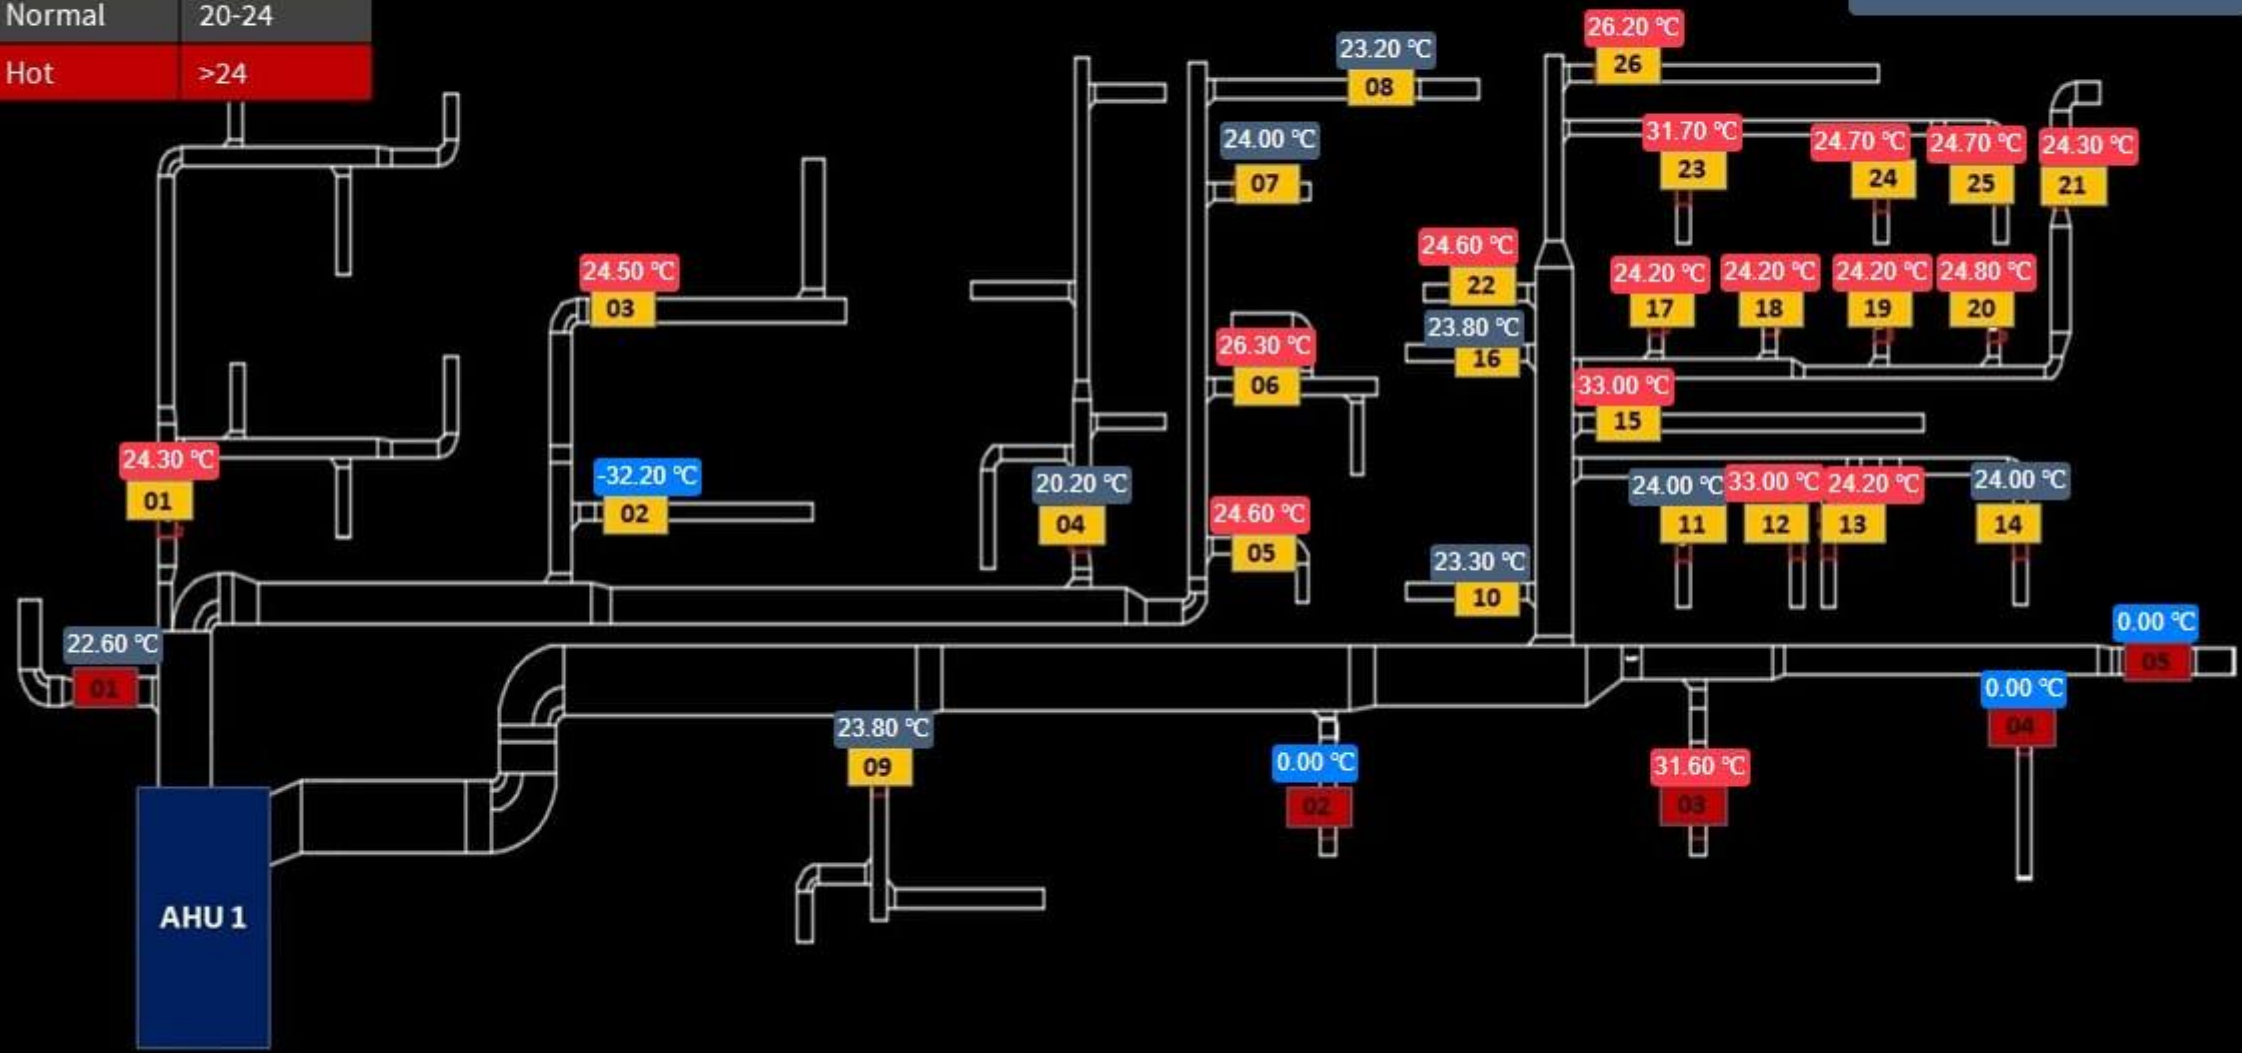

Home

HOMME

LOGO



VAV SUMMARY

18F-AHU01-LAYOUT

ANALYSIS REPORT

TREND LOGS

Syncro

FLOOR LAYOUT


CSU-UNITS

DX-UNIT

AHU-1

AHU-2

TREND LOGS

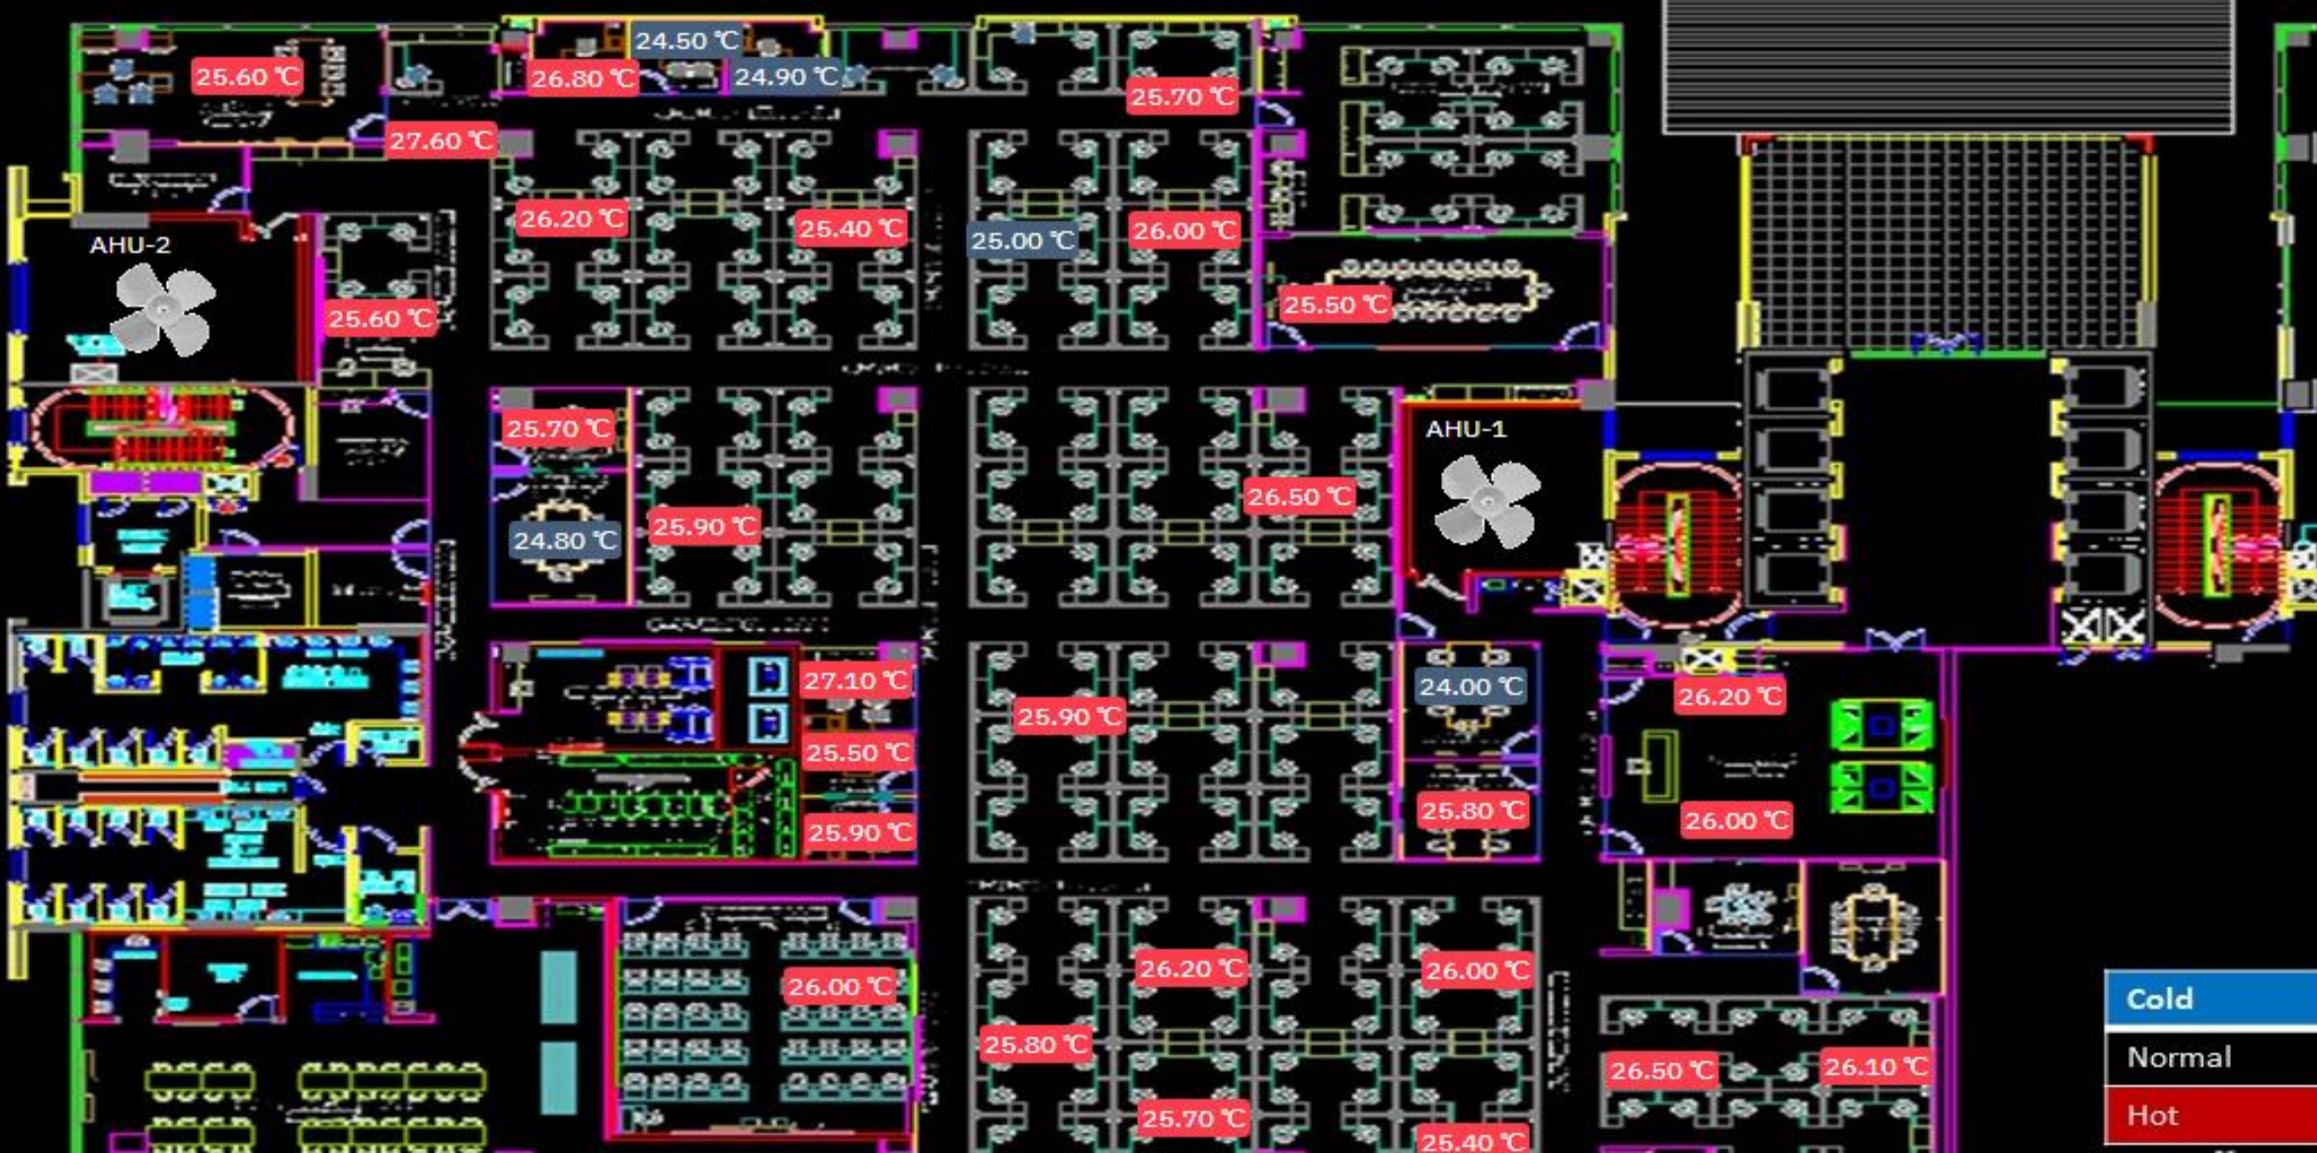

Cold
Normal
Hot